

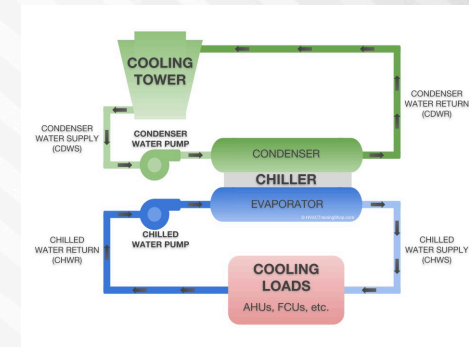


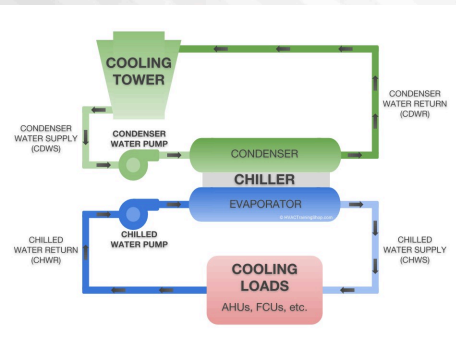

Water Cooled Chiller

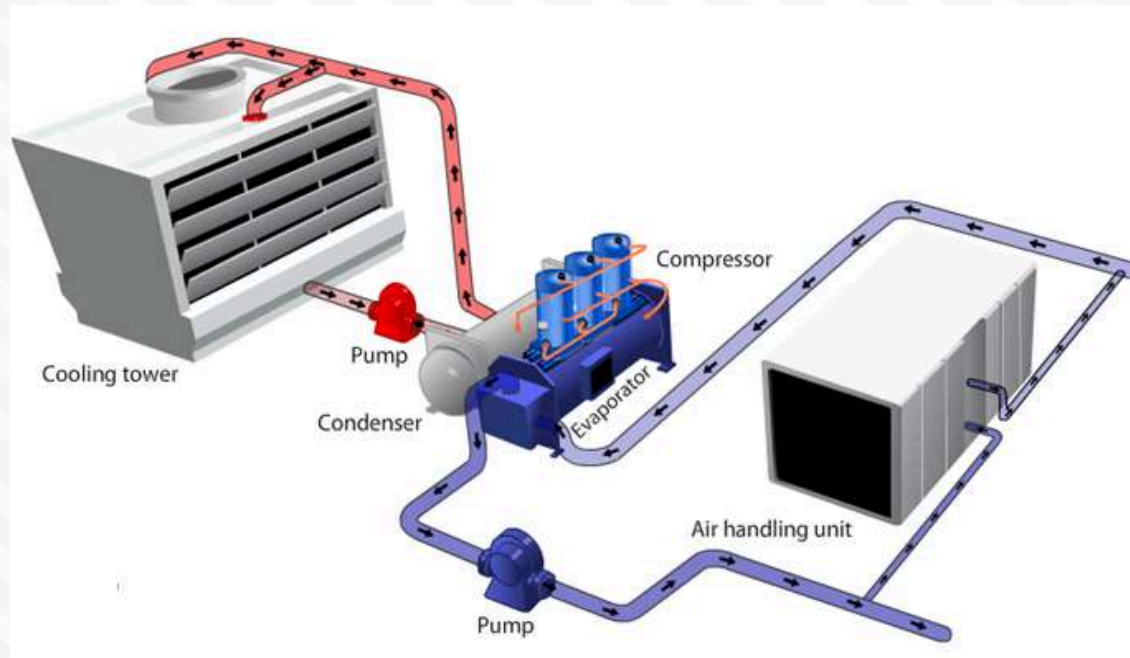


Working & Design


Water Cooled Chiller Designing



Chiller

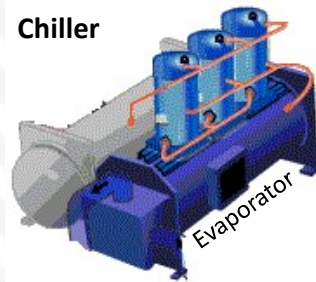

Air handling unit

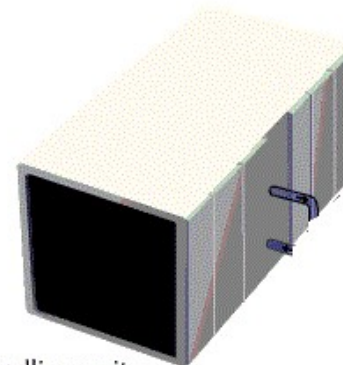


Pump






Water Cooled Chiller Designing

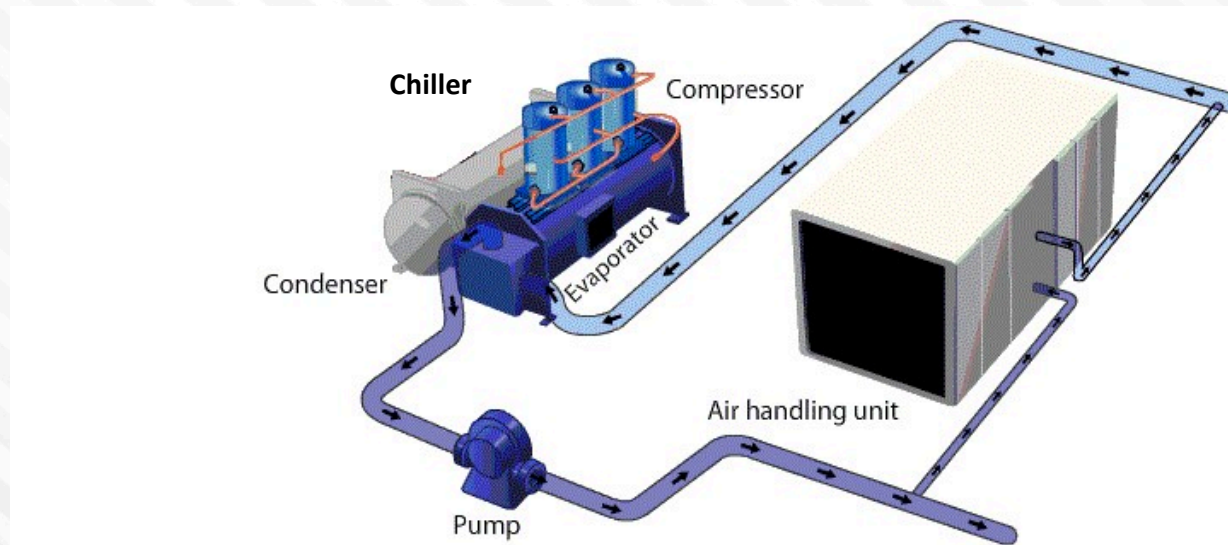






Water Cooled Chiller Designing

- Chilled Water Supply : 44°F
- Chilled Water Return : 54 °F
- ΔT : 10 °F

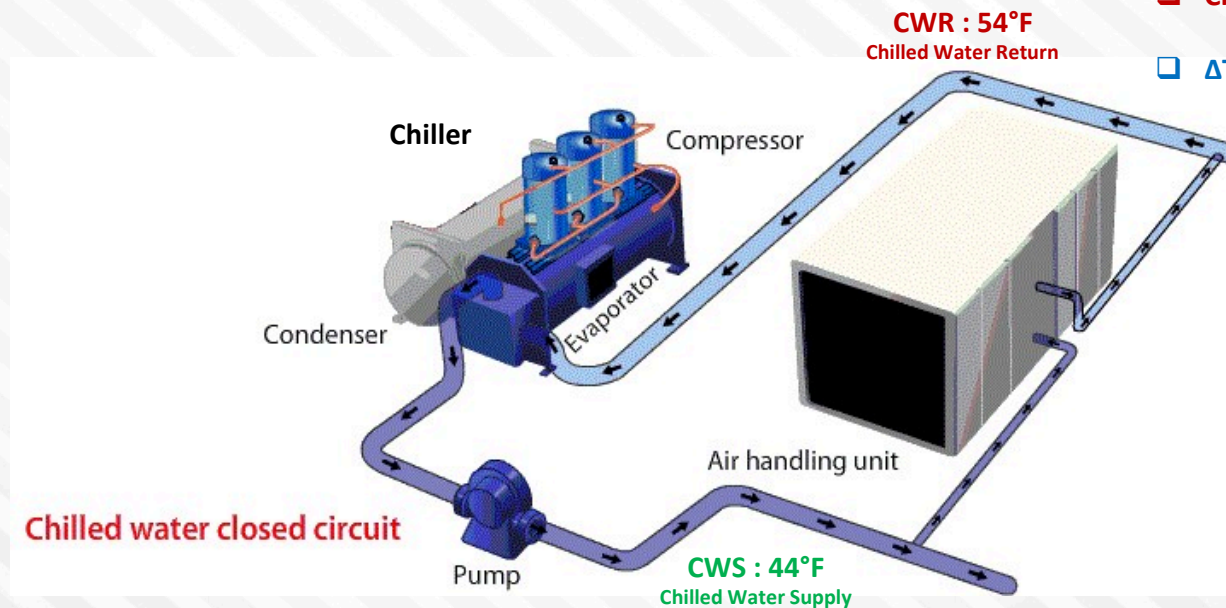


Water Cooled Chiller Designing

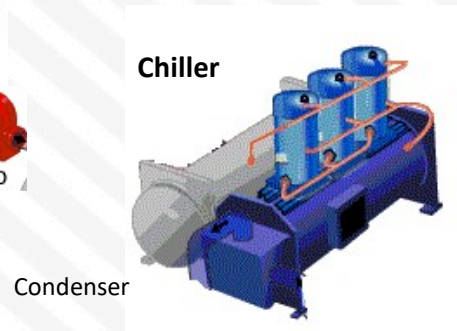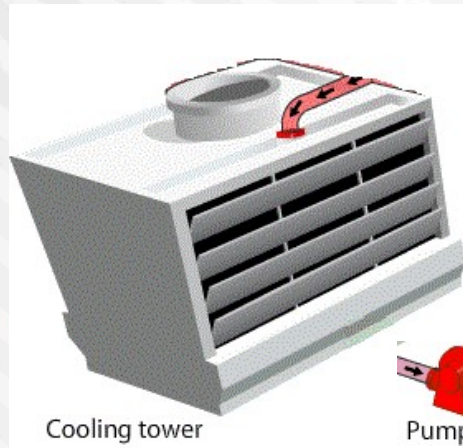

Condenser



Water Cooled Chiller Designing

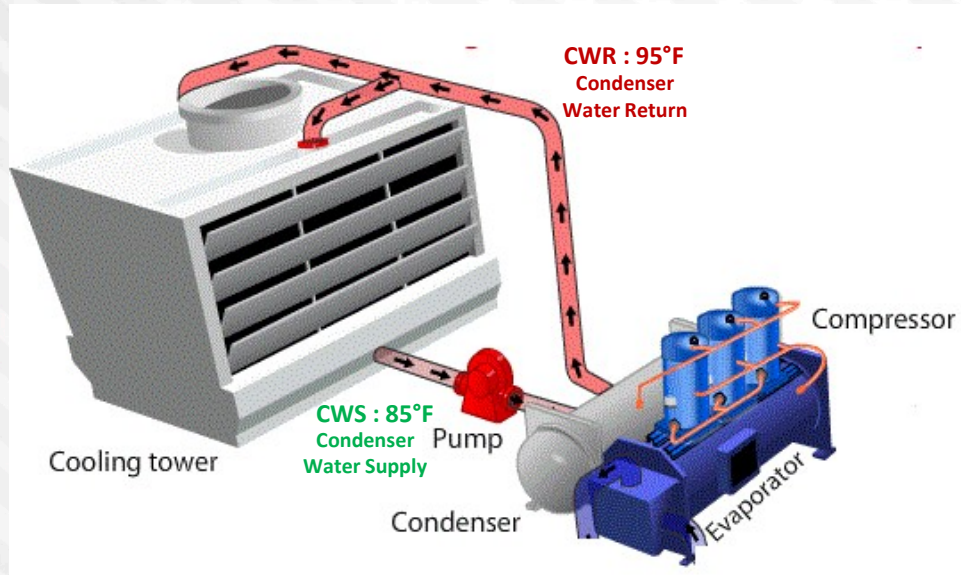


Cooling Tower / Condenser Water – Open Circuit



Water Cooled Chiller Design

Cooling Tower / Condenser Water – Open Circuit

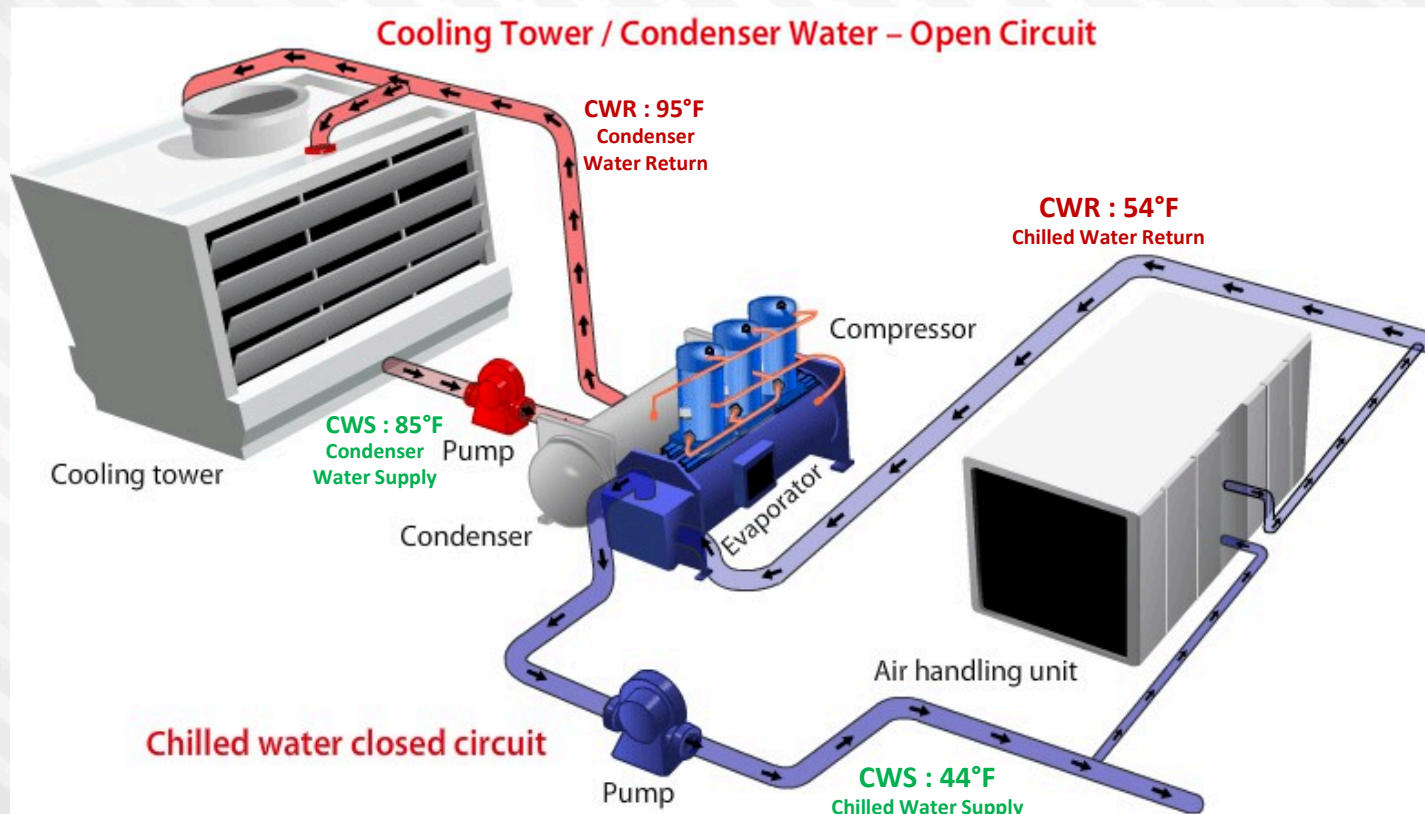



HVAC SIMPLIFIED

